



AlexRenew

RFP 26-011: BIOSOLIDS THERMAL DRYER SYSTEM

PRE-PROPOSAL MEETING AND SITE TOUR | MARCH 17, 2026

Today's presentation is for information only


1. Request for Proposals (RFP) will remain the governing document
2. Only an official addendum will modify the RFP
3. Any questions received at today's Pre-proposal Meeting may be answered verbally. However, oral statements may not be relied upon and will not be binding.

Today's Presenters




Procurement Manager
Igor Scherbakov

Igor joined AlexRenew in 2023 and serves as the Procurement Manager, responsible for AlexRenew's procurement department.

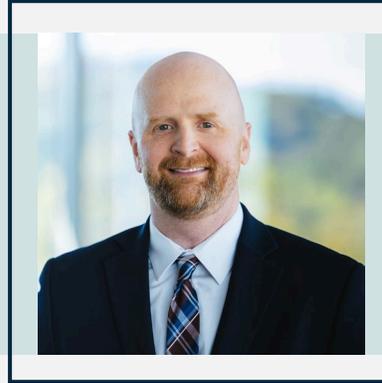

Engineering Manager
Kevin Pilong

Kevin joined AlexRenew in 2023 and serves as the Engineering Manager, responsible for AlexRenew's Engineering Department.

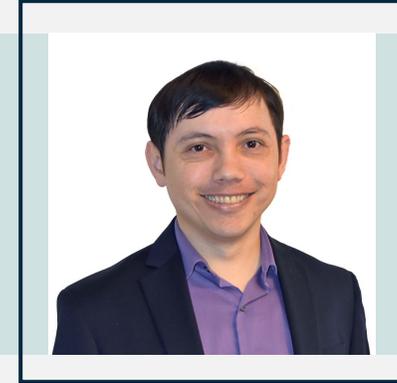

Engineer III
Kyle Chan

Kyle joined AlexRenew in 2020 and serves as an Engineer III, acting as Project Manager on AlexRenew's Biosolids Diversification Project and other projects.

ALEXANDRIA'S WATER SYSTEM



Drinking water distribution system

Virginia American Water



Sanitary and combined sewer system

City of Alexandria



Wastewater treatment and combined sewer outfalls

AlexRenew



Stormwater system

City of Alexandria

AlexRenew

OVERVIEW

Purifies 13 billion gallons of wastewater each year


Serves a population of about 300,000 people in Alexandria and portions of Fairfax County

Established in 1952 as an independent authority

Governed by a 5-member citizen Board



AlexRenew Organizational Chart

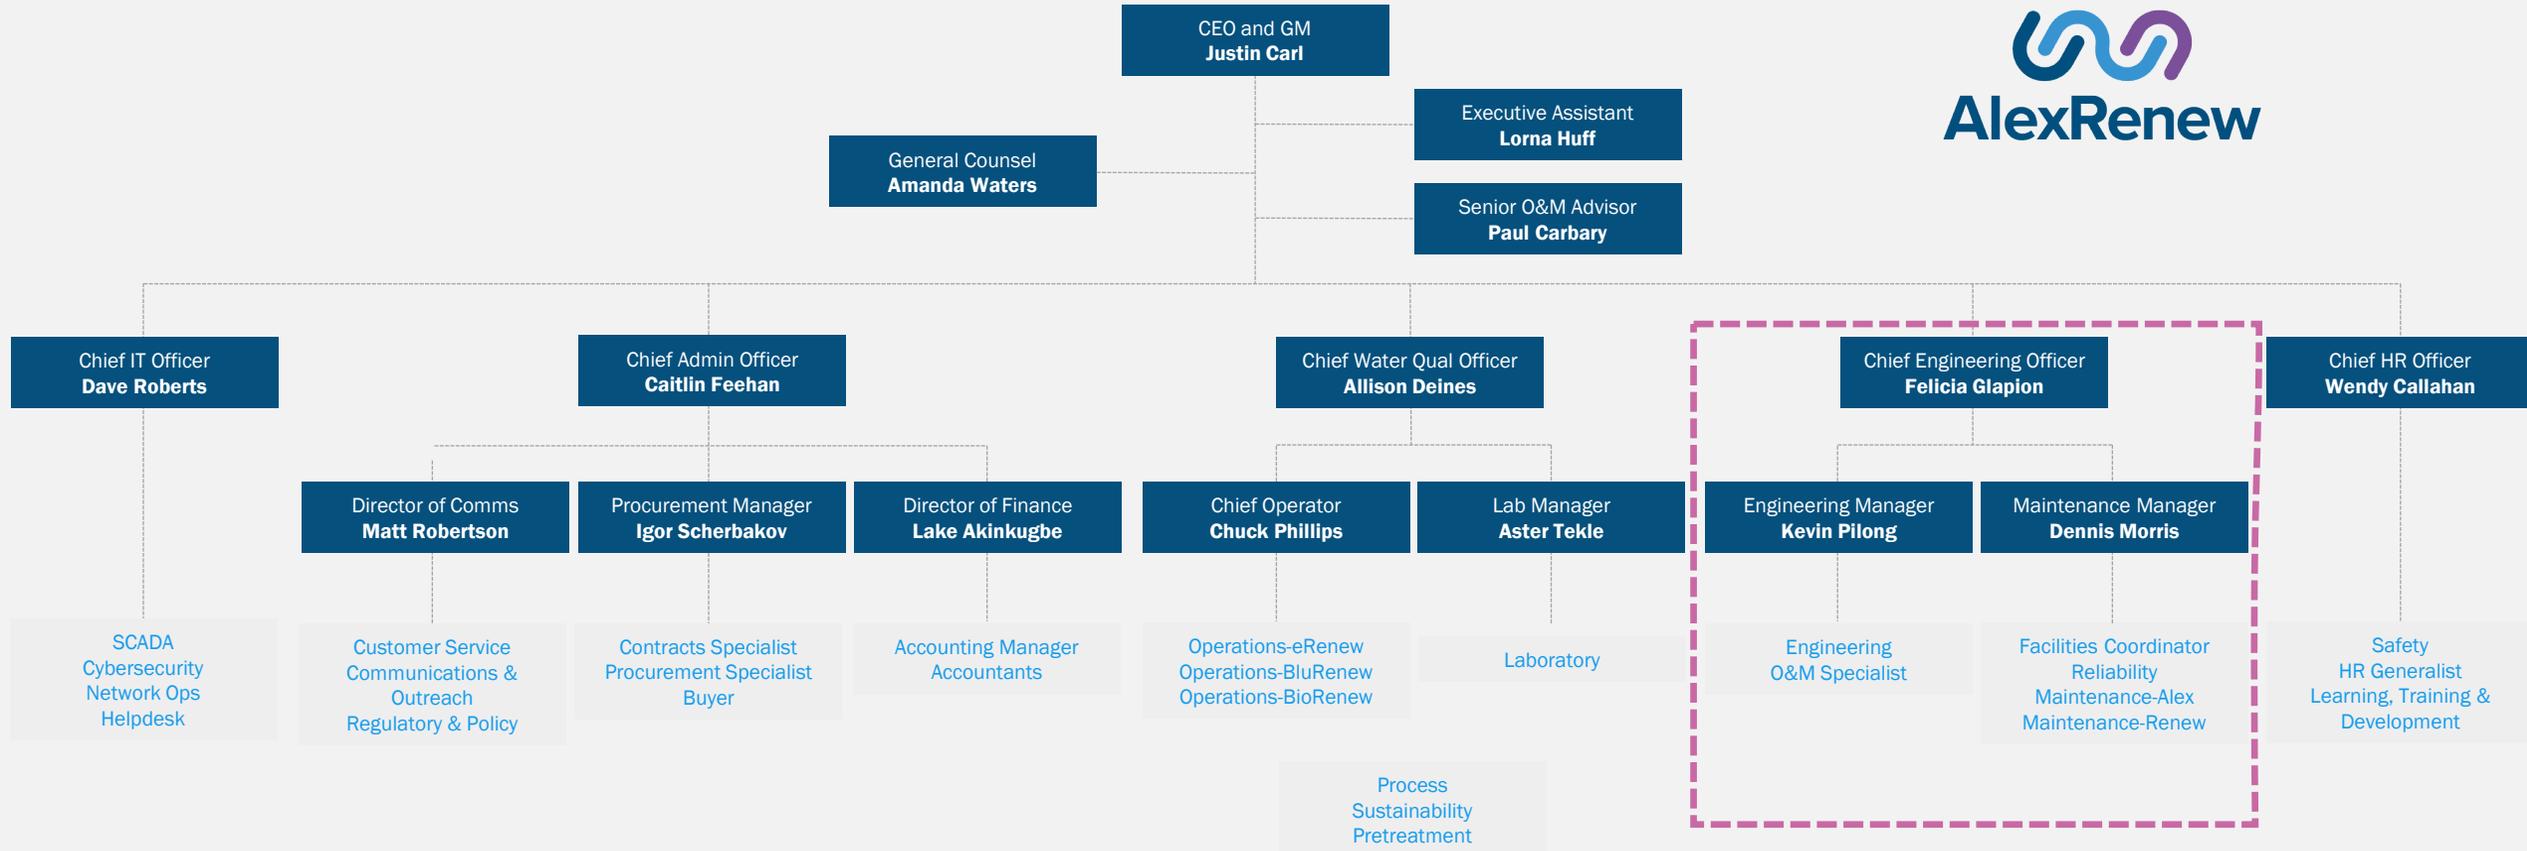



AlexRenew Wastewater Treatment Processes

Tertiary

RiverRenew

Preliminary and
Primary

Building L
Mechanical thickening,
blending, dewatering,
and biosolids handling
and storage

Nutrient
Management
Facility

Secondary and Biological
Nutrient Removal

Building A
Digester gas utilization
and flares


Solids

Building 20
Digestion Complex

UV and
Post-Aeration

Building 55
Pasteurization

Building C
Gravity Thickening 7

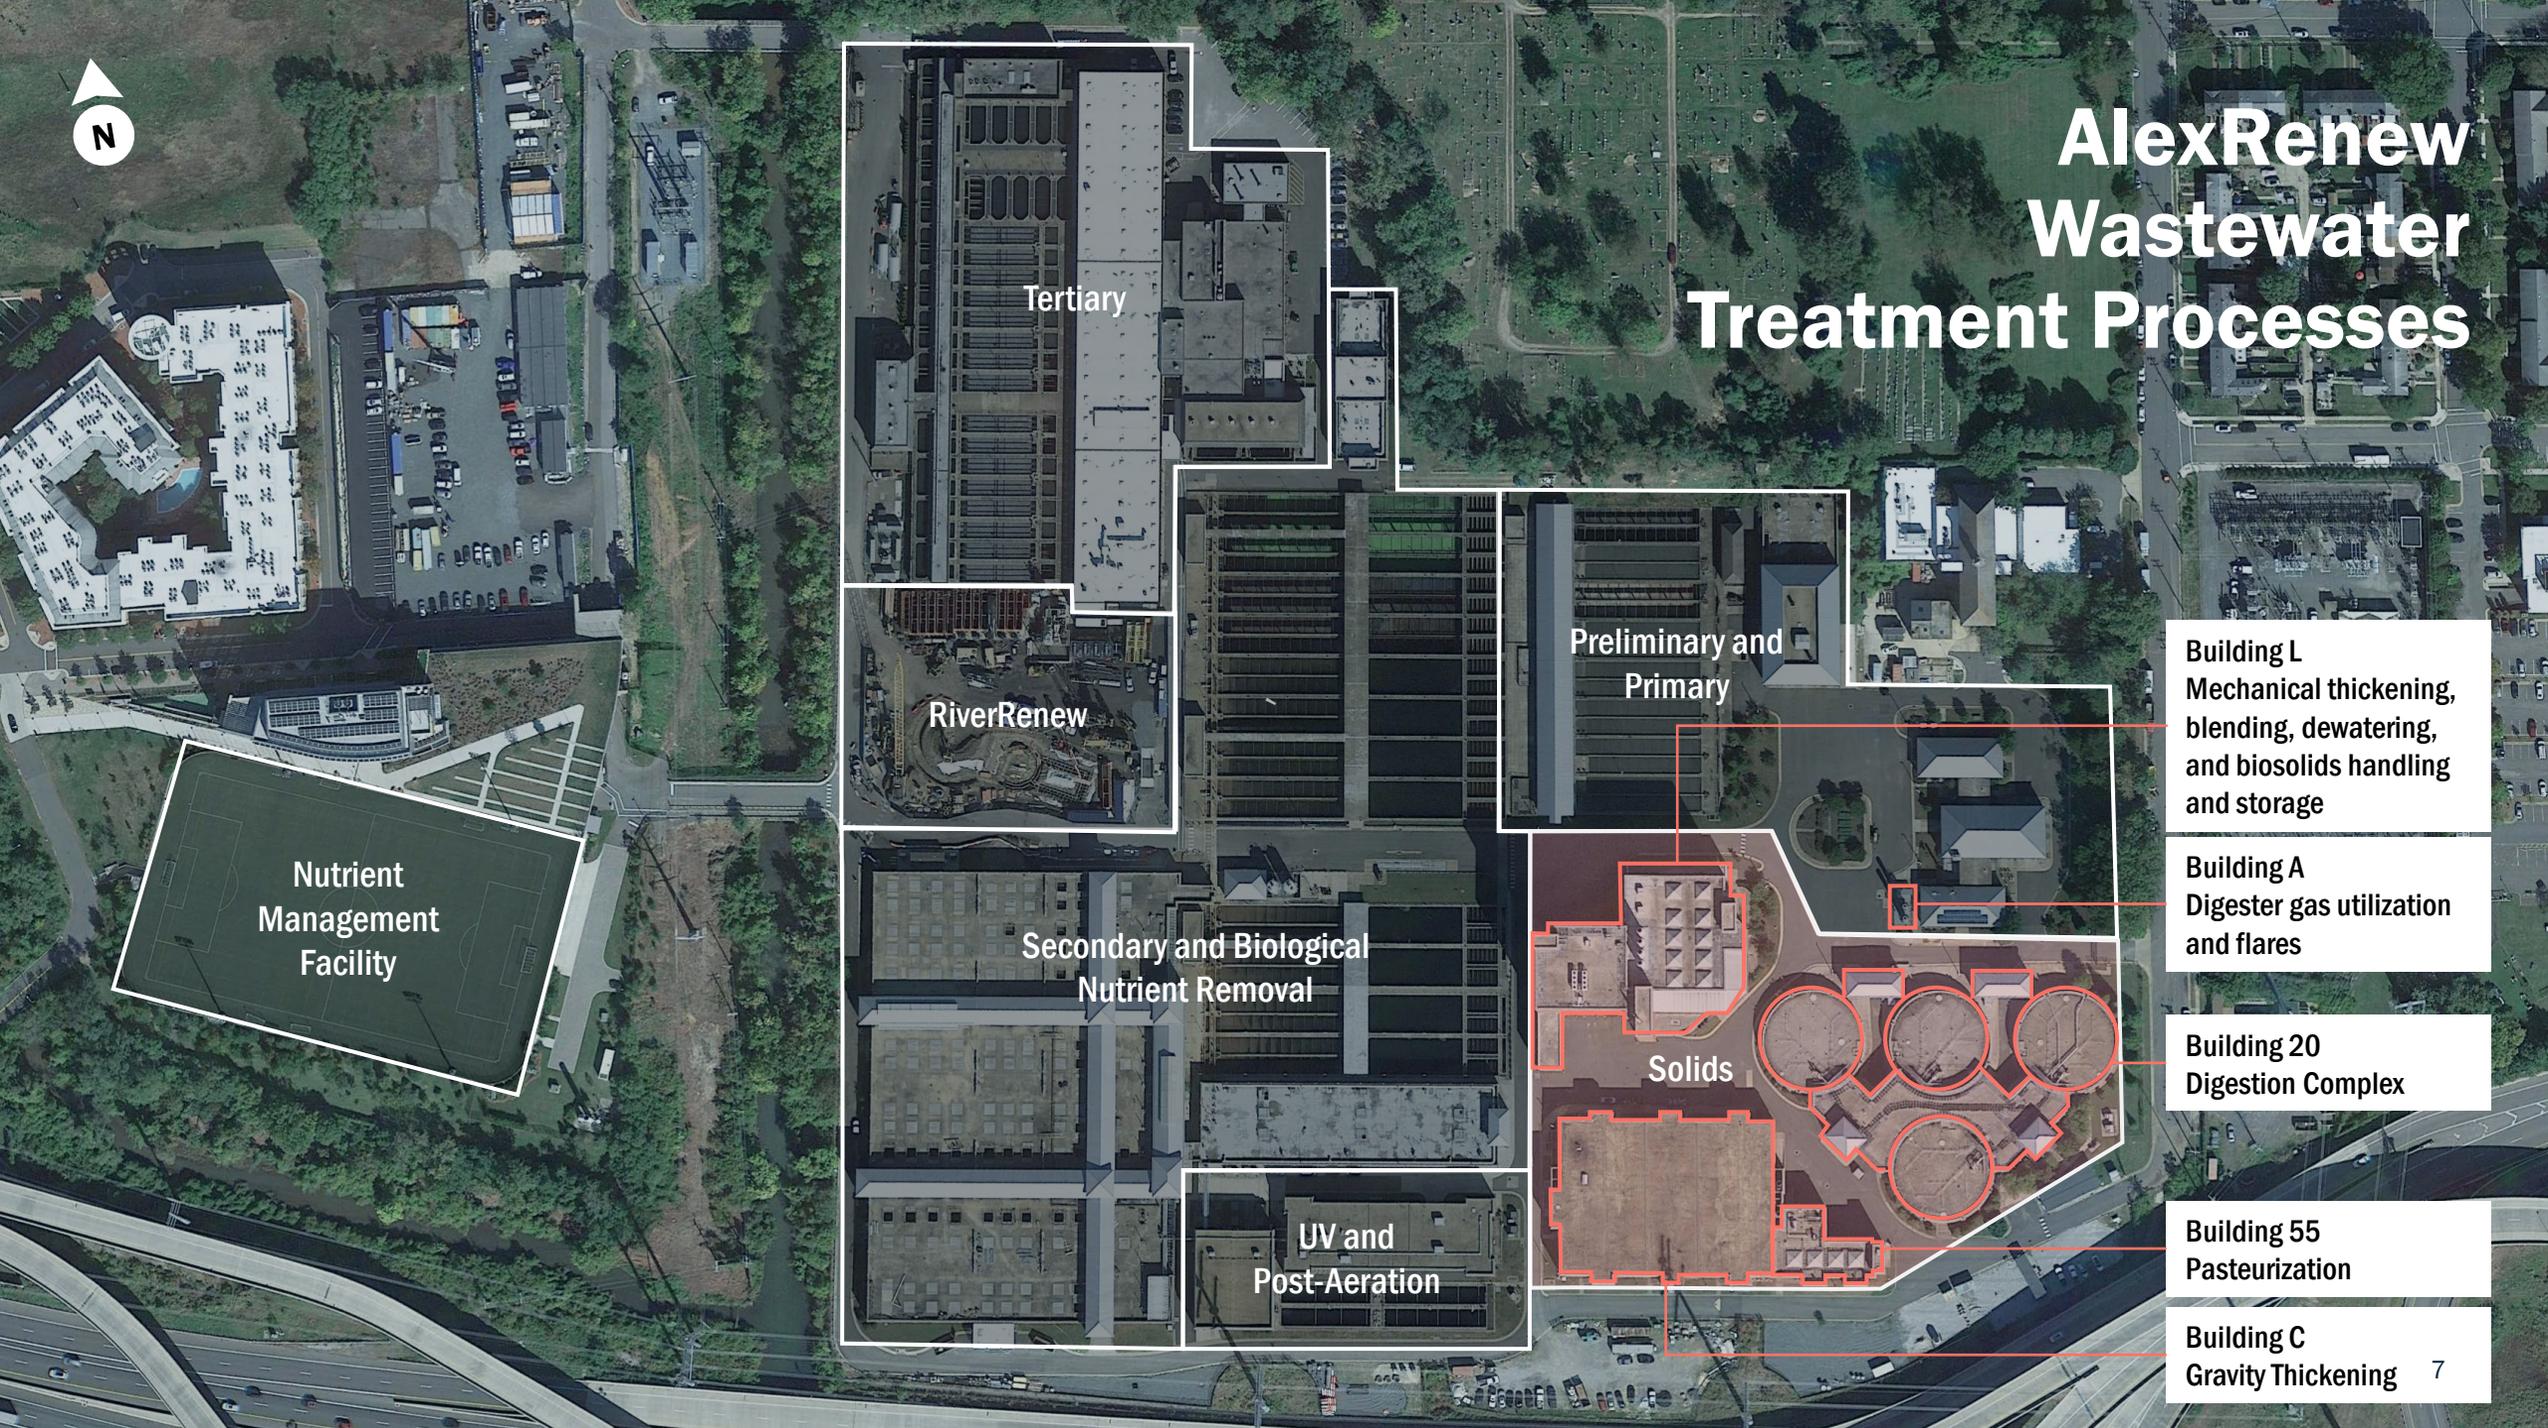



AlexRenew Proposed solids drying facility location

Tertiary

RiverRenew

Preliminary and
Primary

Building L
Mechanical thickening,
blending, dewatering,
and biosolids handling
and storage

Building A
Digester gas utilization
and flares

Building 20
Digestion Complex

Building 55
Demolished

Building C
Gravity Thickening 8


Nutrient
Management
Facility

Secondary and Biological
Nutrient Removal

Solids

UV and
Post-Aeration


Building C
Proposed Drying Facility

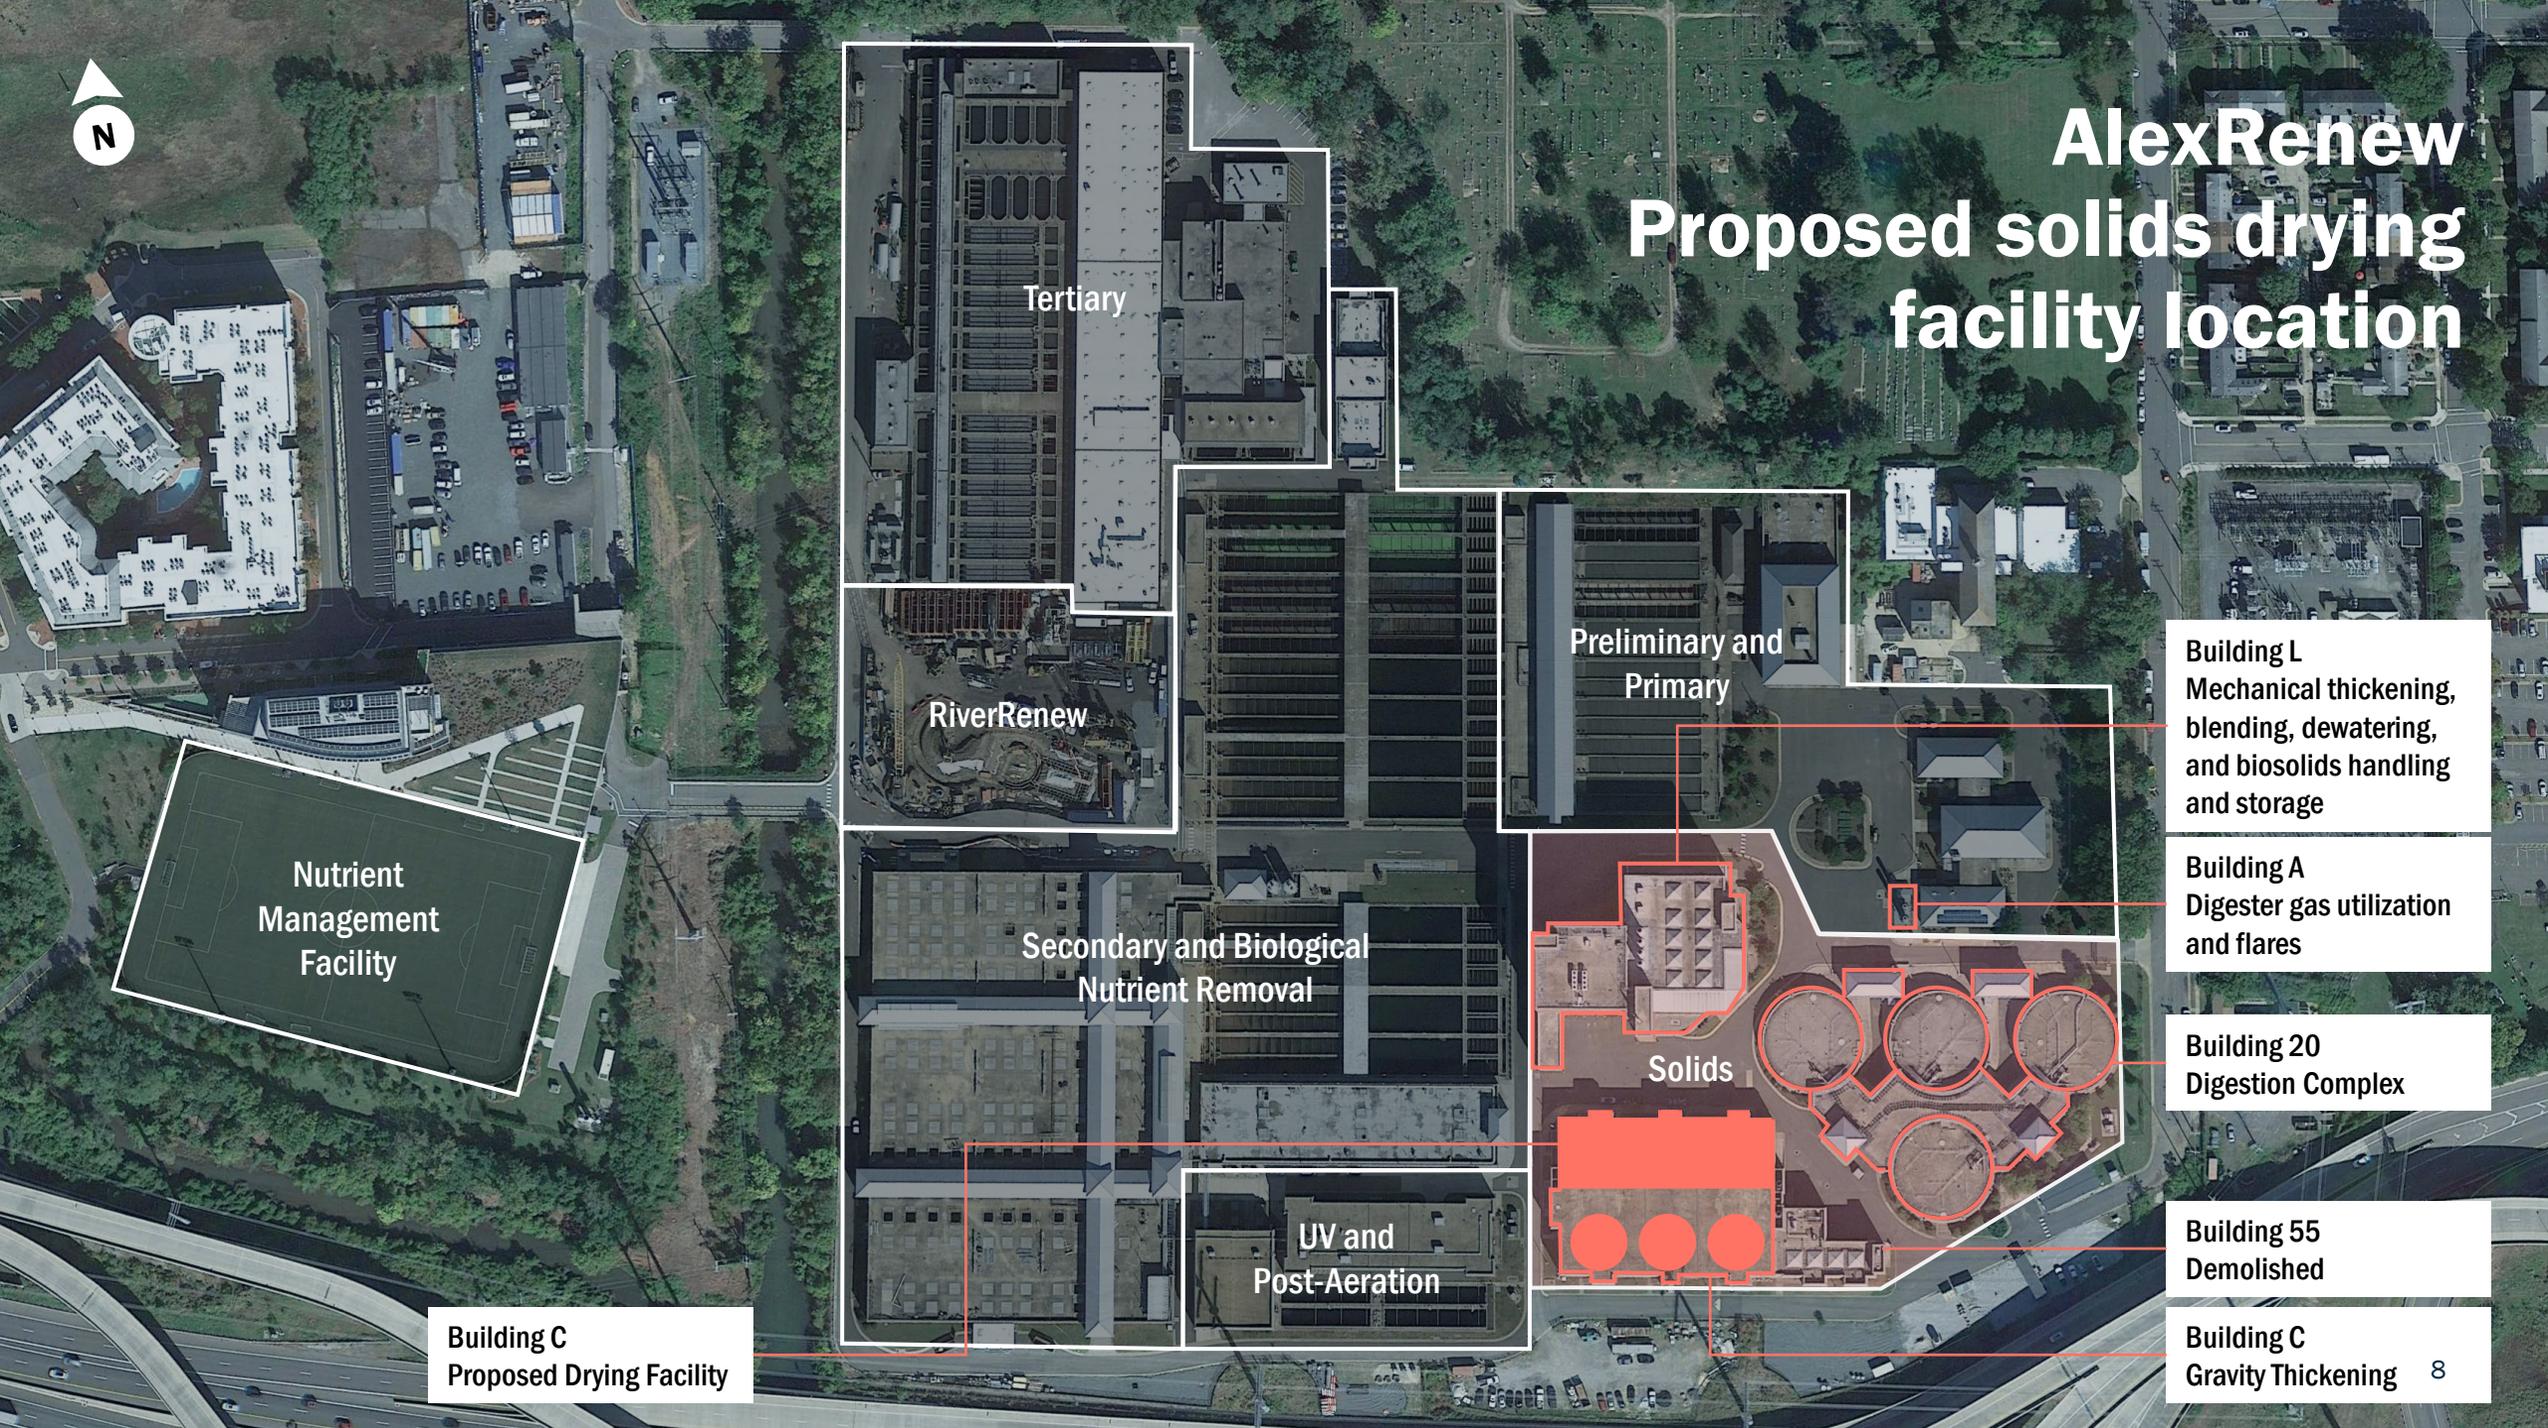

BIOSOLIDS DIVERSIFICATION PROJECT



Payne St

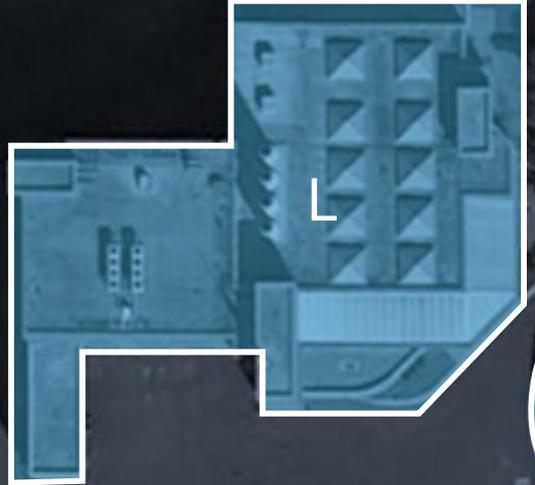

Medium-Term:

- Solids conveyance systems to Building C

Short-Term:

- Gravity thickener system overhaul

Medium-Term:

- Installation of solids dryer and building


Short-Term:

- New thickening and dewatering equipment
- Replacement of sludge mixers



Short-Term:

- Digester heat exchanger replacement
- Digester mixing replacement
- New electrical equipment

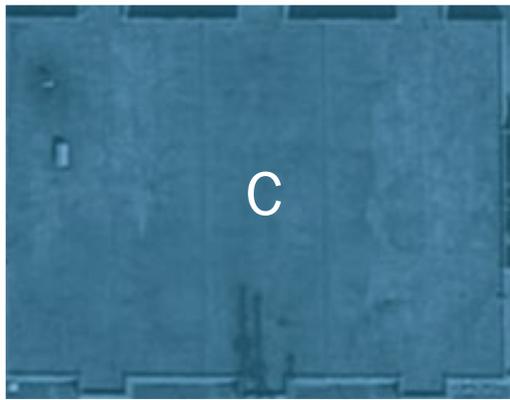


Short-Term:


- Pasteurization decommissioning

AlexRenew Solids Process (current and future)

Current

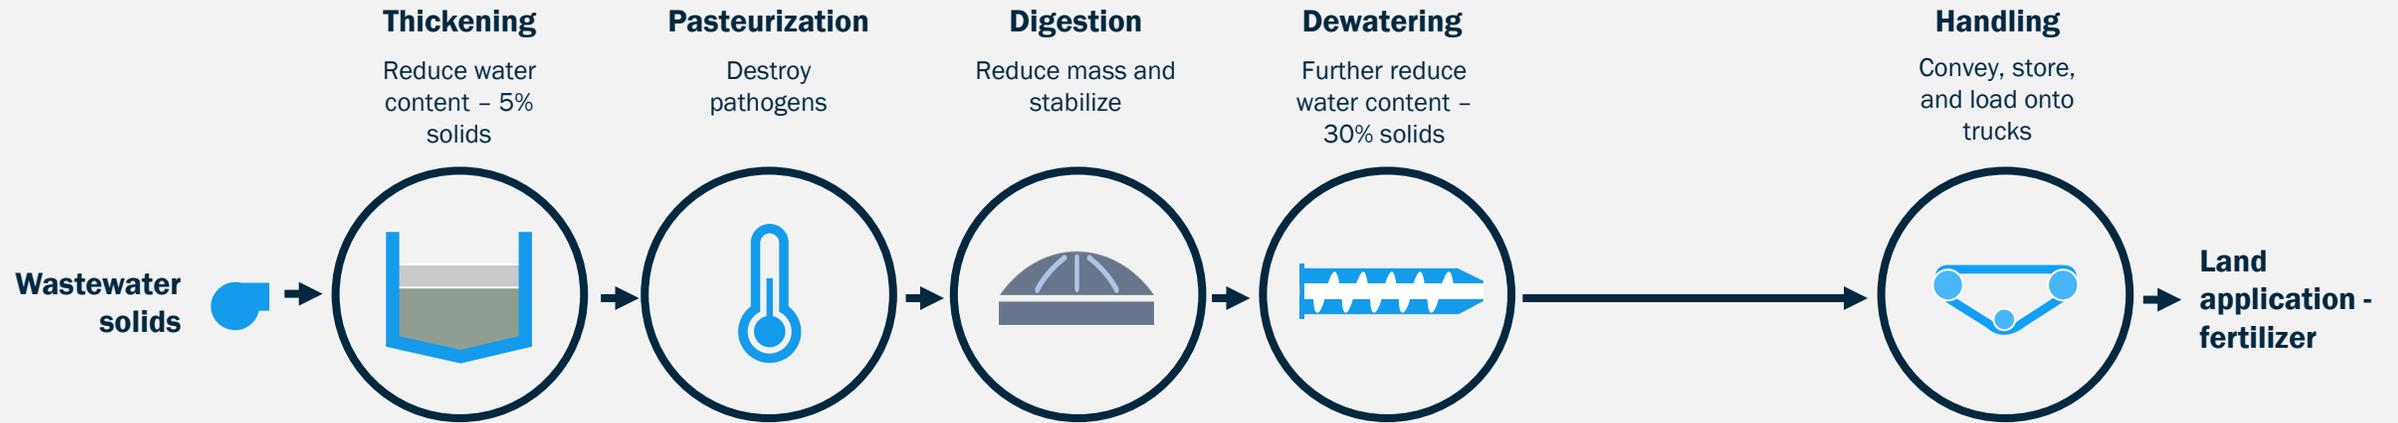


Future

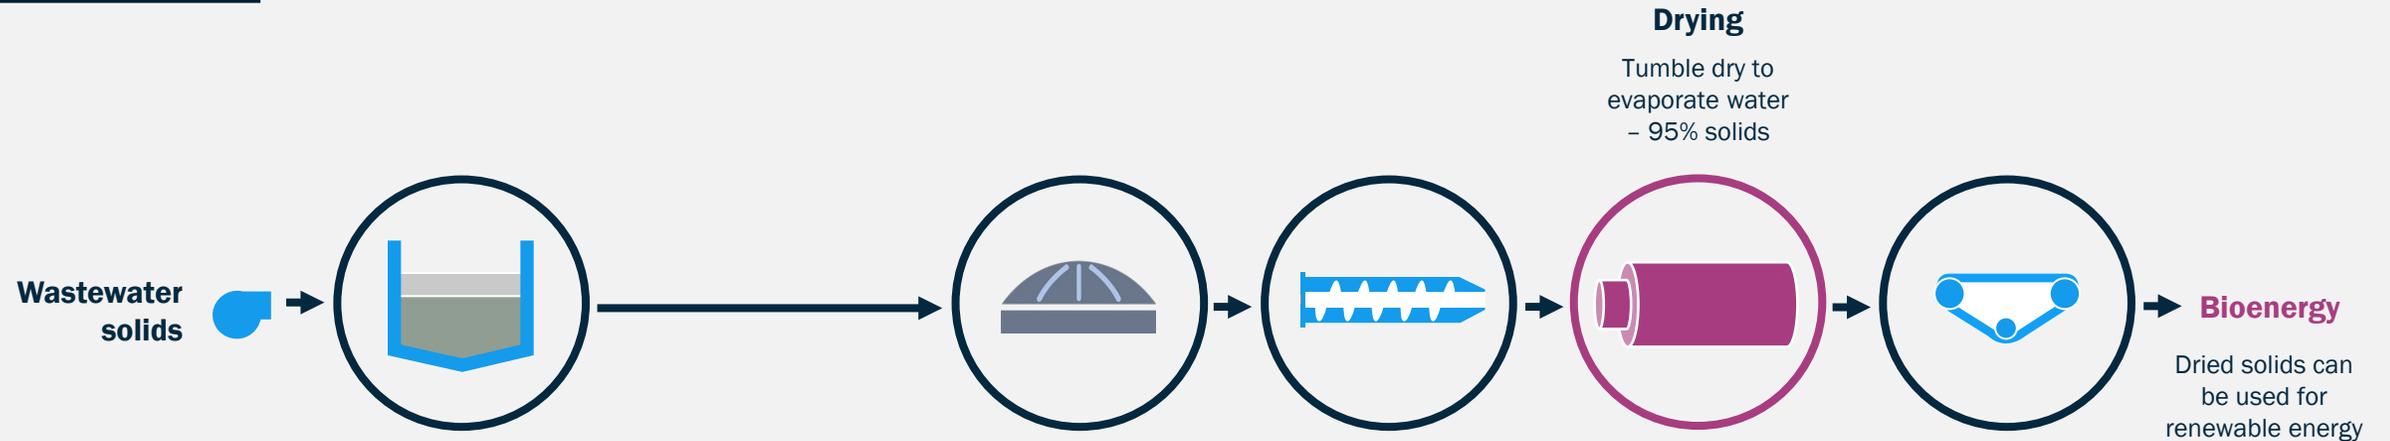

Biosolids Thermal Drying System Scope of Supply

The Biosolids Thermal Drying System will supply equipment for a new plant process to diversify biosolids end uses. The anticipated scope of supply includes the following major items.

- **Triple pass rotary drum drying system.** Furnish complete system including, but not limited to:
 1. Two (2) wet material bins with live bottom screws, each with two (2) cake pumps (total of four cake pumps)
 2. Two (2) complete drum drying and pelletization systems with emissions controls
 3. Two (2) pneumatic product transport systems
 4. Two (2) dry product storage silos
 5. One (1) nitrogen storage tank and vaporizer system

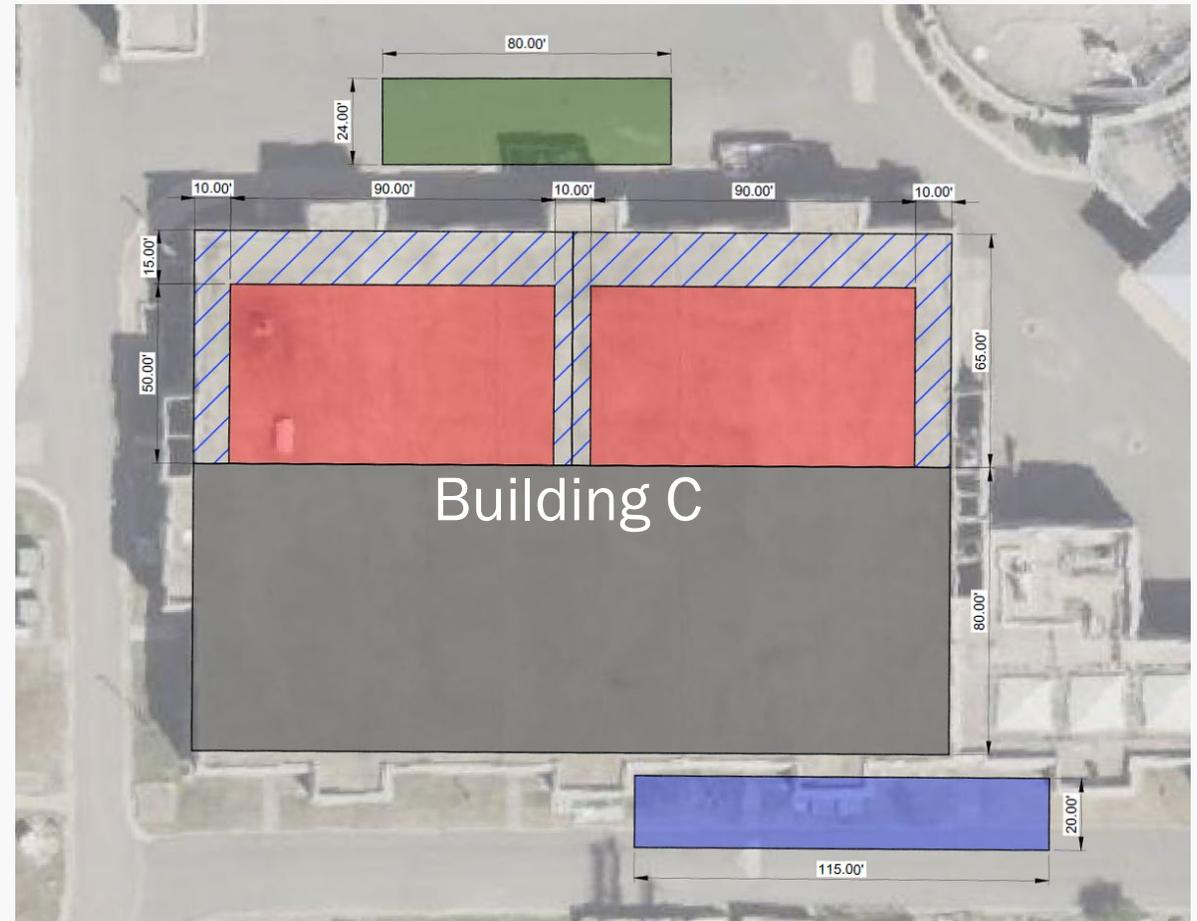

Allocated building footprint, final location of equipment to be determined as part of design

Biosolids Thermal Drying System Technical Requirements

The proposed solution shall comply with the Technical Requirements summarized below and detailed in Attachment B of the RFP.

Table 2.1 Dewatered Sludge Feedstock Design Criteria

Parameter	Specification/Value
Feed sludge type	Municipal, dewatered cake, anaerobically digested, screened, amended with ferric chloride
Feed cake total solids content (minimum/ maximum)	20% TS/ 27% TS
Dry product total solids content (minimum/ maximum)	92% TS/ 95% TS

Table 2.2 Biosolids Thermal Dryer Design Criteria

Parameter	Specification/Value
Dryer type	Rotary drum
Number of dryer trains (duty/ standby)	2 total (1 duty/ 1 standby)
Required runtime	24 hours/ day; 7 days/week
Minimum turndown	30% of design capacity
Design evaporative capacity per dryer train	13,228 lbs H2O/hr
Fuel type	Dual fuel (natural gas and digester gas)
Emissions	Facility is located in an area of ozone-non-attainment. Air pollution controls for VOCs and ultra-low NOx will potentially be required

Biosolids Thermal Drying System Scope of Services

The Biosolids Thermal Drying System scope of services is expected to occur in three phases

- **Phase 1: Design Services.** Preparation and submission of shop drawings, design calculations, control narratives, equipment data, and other engineering documentation required for review and coordination with the project design.
- **Phase 2: Fabrication and Delivery.** Manufacture, factory testing, and delivery of the biosolids thermal drying system and associated equipment.
- **Phase 3: Field Services and Commissioning.** Provide technical field support for installation, testing, commissioning, start-up, and training. Option for short-term operations contract (e.g. 1 year) may be requested during negotiations
- **Assignment to CMAR:** Upon completion of Phase 1, the contract will be assigned to the CMAR such that the Successful Respondent's contract obligations for Phases 2 and 3 will be directly with the CMAR.



Dewatered biosolids product




Biosolids conveyer



Dried biosolids pellets

Biosolids Thermal Drying System Contract Arrangement

AlexRenew will enter into a Contract with the Successful Respondent to perform the scope of services. Upon completion of Phase 1, the Contract will be assigned to the CMAR.

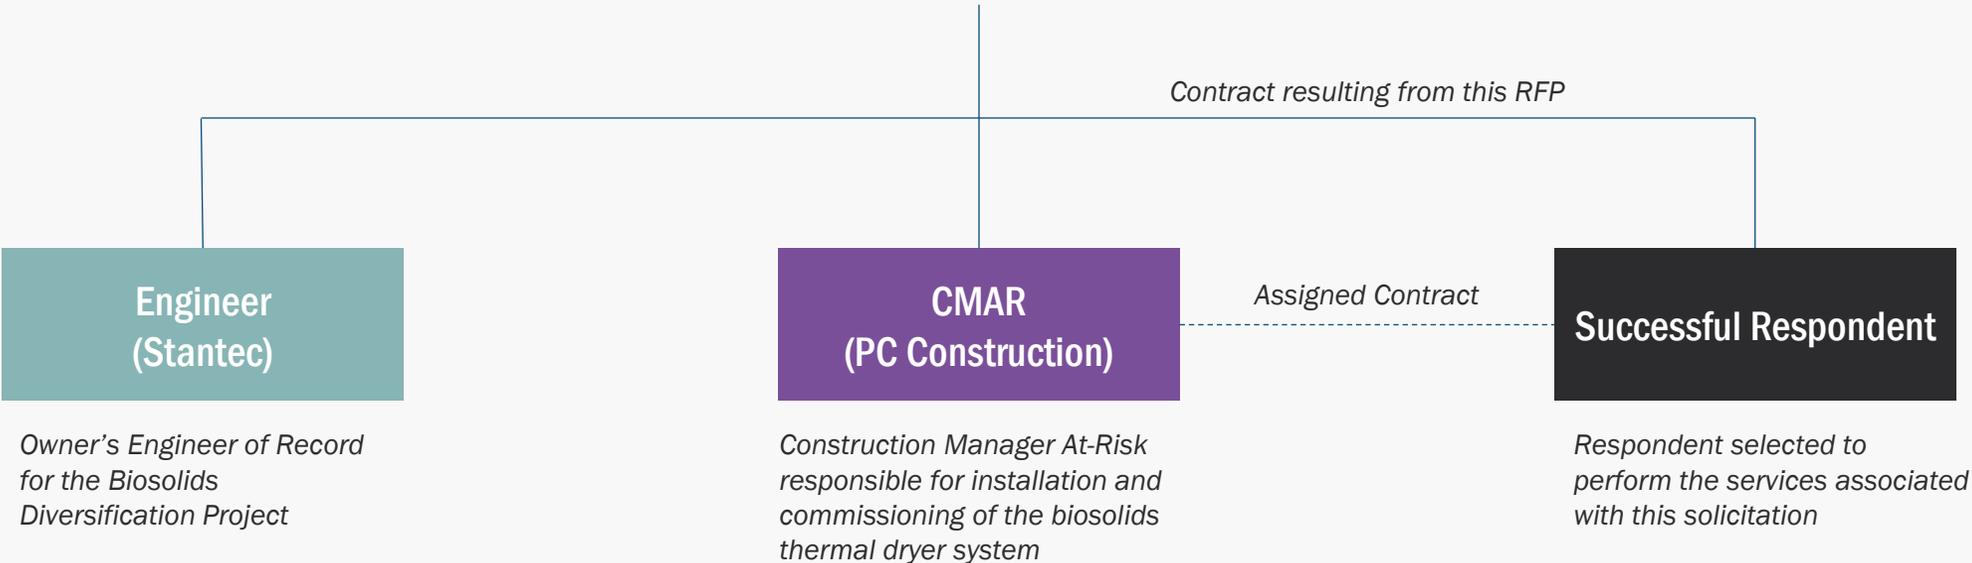


RFP-26-011 EVALUATION CRITERIA

Manufacturer and Support Capabilities


Narrative, team structure, technical support process, and support personnel

20

3-5 Key Personnel with resumes



Design staff



Service and Maintenance Staff

Technical and Operational Performance

Scope of supply, layout drawings, equipment and spares list, operations contract, typical commissioning plan, draft warranty certification:

40



Meets requirements of Attachment B

Demonstrated Experience

Narrative, the below table, and list of USA installations


40

6 Example projects in the last **10** years



Example Projects

RFP 26-011 Procurement Timeline

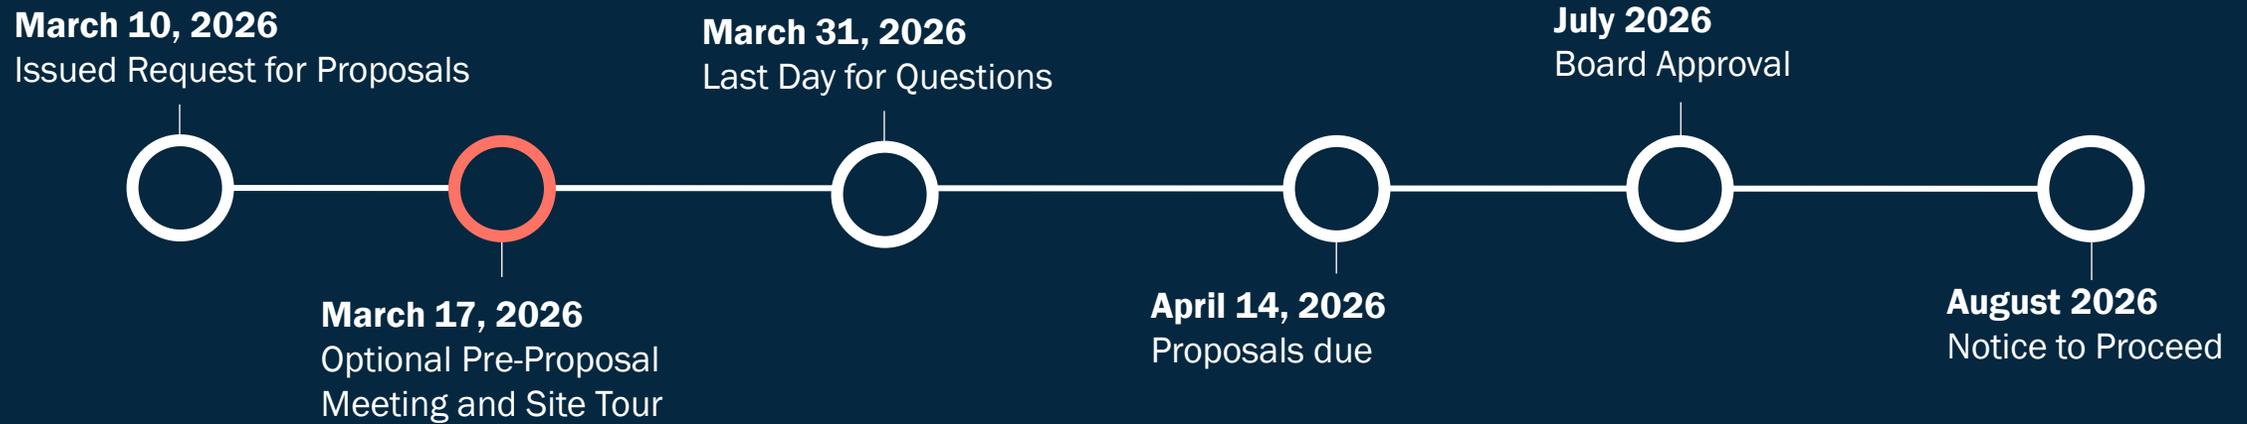

Anticipated Project Schedule

Timing of the project, highlighting procurement milestones and expected duration of services.



The schedule dates are approximate and are non-binding. They are provided for Respondents' information only. However, similar dates and durations as well as milestones may be included in the Contract between AlexRenew and Successful Respondent.



AlexRenew's gravity thickeners inside Building C

Next Steps

- Presentation will be posted on AlexRenew's website
- Submit questions via dryer-26-011@alexrenew.com
- Last day for questions March 31, 2026
- Submit proposals April 14, 2026 by 2:00 PM
- Notifications of Shortlist by May 28, 2026
- Anticipated Contract Award and Issue Notice-to-Proceed by August 2026



AlexRenew's Truck Loading Area in Building L



AlexRenew